


SITE PLAN OF 415 LLC SITUATE AT MONTAUK

TOWN OF EAST HAMPTON
SUFFOLK COUNTY, NEW YORK
S.C.T.M. DIST. 0300 SEC. 11 BLK. 05 LOT 25



LOT AREA: 18,205 SQ. FT. = 0.418 ACRE
ELEVATIONS HEREON REFER TO APPROX. MSL DATUM
AND ARE THE RESULT OF ACTUAL FIELD MEASUREMENTS

NO SURFACE WATER WITHIN 300' OF SITE
NO WELLS WITHIN 150' FROM ALL PROPERTY LINES

SITE ADDRESS 415 WEST LAKE DRIVE, MONTAUK, N.Y.

NO UNDERGROUND STORAGE OR OIL TANKS

SCHOOL DISTRICT: MONTAUK
FIRE DISTRICT: MONTAUK
ZONING DISTRICT: RS

FLOOD ZONE BOUNDARY AS SCALED FROM THE F.E.M.A.
FLOOD INSURANCE RATE MAP
MAP NO. 36103C0254 H - EFFECTIVE DATE: SEPTEMBER 25, 2009

ALLOWABLE LOT COVERAGE: 2,731 SQ. FT. = 15%
EXISTING: 986 SQ. FT.
PROPOSED: 1,653 SQ. FT. = 9.1%

ALLOWABLE TOTAL LOT COVERAGE: 13,654 SQ. FT. = 75%
EXISTING: 3,210 SQ. FT. = 17.6%
PROPOSED ADDITIONAL: 1,679 SQ. FT.
PROPOSED TOTAL: 4,889 SQ. FT. = 26.9%

ALLOWABLE CLEARING: 10,999 SQ. FT. OR 75% WHICHEVER IS GREATER: 13,654 SQ. FT.
PARCEL 100% CLEARED EXCEPT A FEW REMAINING LARGE TREES

ALL CLEARED AREAS OTHER THAN BUILDINGS AND DRIVEWAYS
TO BE STABILIZED WITH GRASS

PARKING CALCULATIONS:
MULTIPLE RESIDENCE


REQUIRED PARKING: 2 PER UNIT

2 UNITS X 2 = 4 TOTAL SPACES
1 HANDICAP PARKING STALL PROVIDED.

SEE SEPARATE ENGINEERING PLAN FOR SANITARY DESIGN & DETAILS

CERTIFIED TO: SEAN MURPHY
415, LLC


JOB NO.: 2011-196 L25
MAP NO.:
FILED:
REVISIONS:
ADD PROP. C.E. 10/8/18
REV. PARKING, REV. LC CALC'S 11/8/18
REV. SITE PLAN, ADD ENGINEERED DRAINAGE
& PROP. SAN. SYS. 12/31/18
REV. SITE PLAN 3/7/19
REV. ENGINEERED DRAINAGE & PROP.
SAN. SYS. 3/26/19
ADD HANDICAP STALL FOR PLANNING APPROVAL 8/26/2019

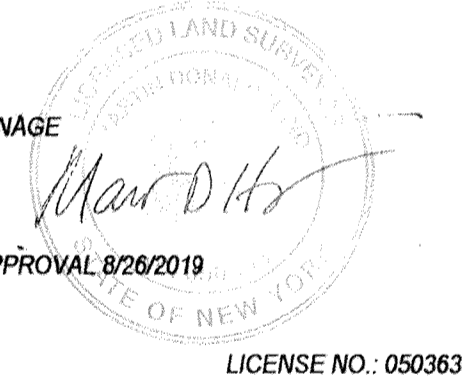


HANDS ON SURVEYING
26 SILVER BROOK DRIVE
FLANDERS, NEW YORK
11901
TEL: (631) 369-8312 - FAX: (631) 369-8313
MARTIN D. HAND L.S.

COPIES OF THIS SURVEY MAP, EITHER PAPER OR ELECTRONIC, NOT BEARING
THE LAND SURVEYORS INKED SEAL OR EMBOSSED SEAL SHALL NOT BE
CONSIDERED TO BE A VALID COPY AND SHALL NOT BE USED FOR ANY PURPOSE.

KEY MAP

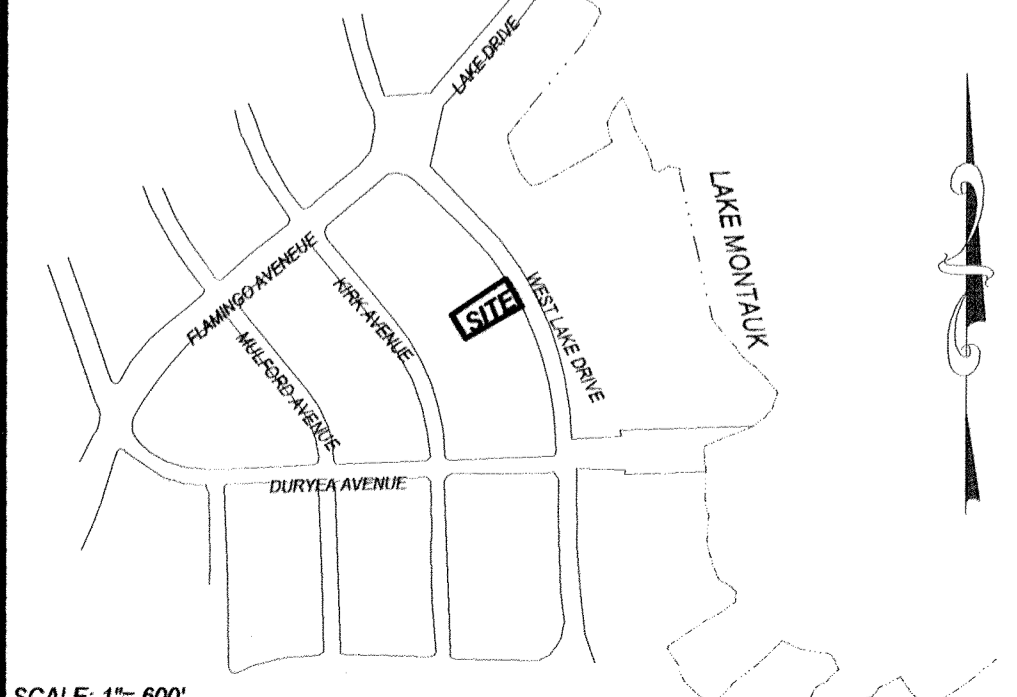

TRENCH DRAIN DETAIL

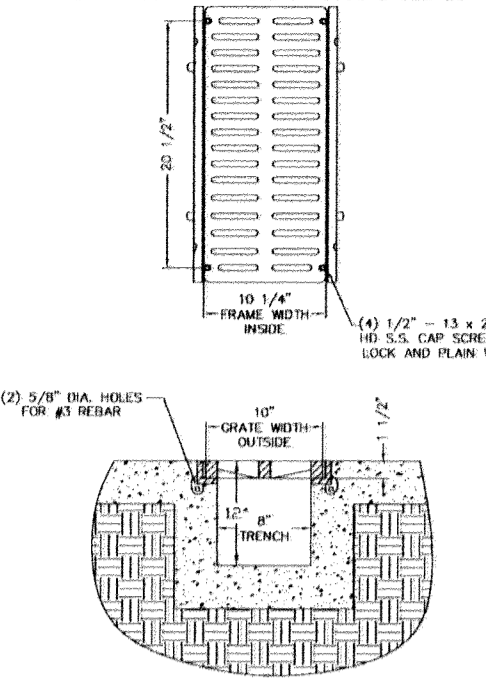


DRAINAGE CALCULATIONS:

ROOF DRAINAGE
ROOF AREA UNIT A = 1,418 S.F. x 1.00 x 0.17 = 241 C.F.
REQUIRED = 241 C.F./42.24 V.F. = 5.7 FT
PROVIDE = (2) - 8" DIA. x 3' EFF. DEPTH POOLS = 253 V.F.

ROOF DRAINAGE
ROOF AREA UNIT B = 685 S.F. x 1.00 x 0.17 = 117 C.F.
REQUIRED = 117 C.F./42.24 V.F. = 2.8 FT
PROVIDE = (2) - 8" DIA. x 2' EFF. DEPTH POOLS = 169 V.F.

DRIVEWAY DRAINAGE
GRAVEL DRIVEWAY 618 S.F. x 0.5 x 0.17 = 52.5 C.F.
ASPHALT DRIVEWAY 1,163 S.F. x 1 x 0.17 = 198 C.F.
REQUIRED = 251 C.F./42.24 V.F. = 5.9 V.F.
PROVIDE = (1) - 8" DIA. x 6' EFF. DEPTH POOLS = 253 V.F.

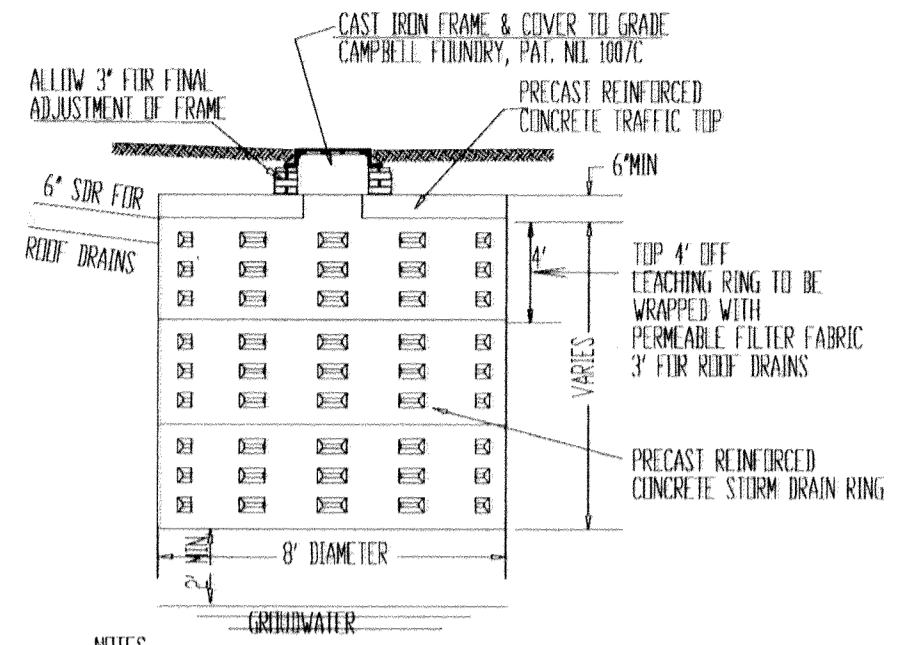

TEST HOLE DATA

MIXED SAND & LOAM	EL: 14.0'
BROWN CLAYEY SAND (SC)	2.0'
WATER IN BROWN CLAYEY SAND (SC)	13.6' EL: 0.4'
WATER IN BROWN FINE TO COARSE SAND W/ GRAVEL (SW)	15.0'
	23.0'



TEST HOLE BORING BY
McDONALD GEOSCIENCE
12/12/2018
WATER ENCOUNTERED 13.6'
BELOW SURFACE

OLF - DENOTES HIGH HAT LIGHT FIXTURE
SEE DETAILS TO BE PROVIDED BY OTHERS




- NOTES
1. CONCRETE - 4000 PSI AT 28 DAYS
 2. ALL DRAINAGE COMPONENTS TO BE TRAFFIC RATED IN PAVED AREAS
 3. ALL DRAIN RINGS SHALL BE 2" MIN. ABOVE GROUNDWATER
 4. STORM DRAINS SHALL NOT BE COMBINED WITH ROOF DRAINS
 5. GRATE AND TRAFFIC TOP TO BE USED IN DRIVEWAY
 6. 6" THICK TOP TO BE USED IN GRASS AREAS
 7. DRAINAGE STRUCTURES TO BE 10' FROM WATER LINES

STORMWATER DRYWELL

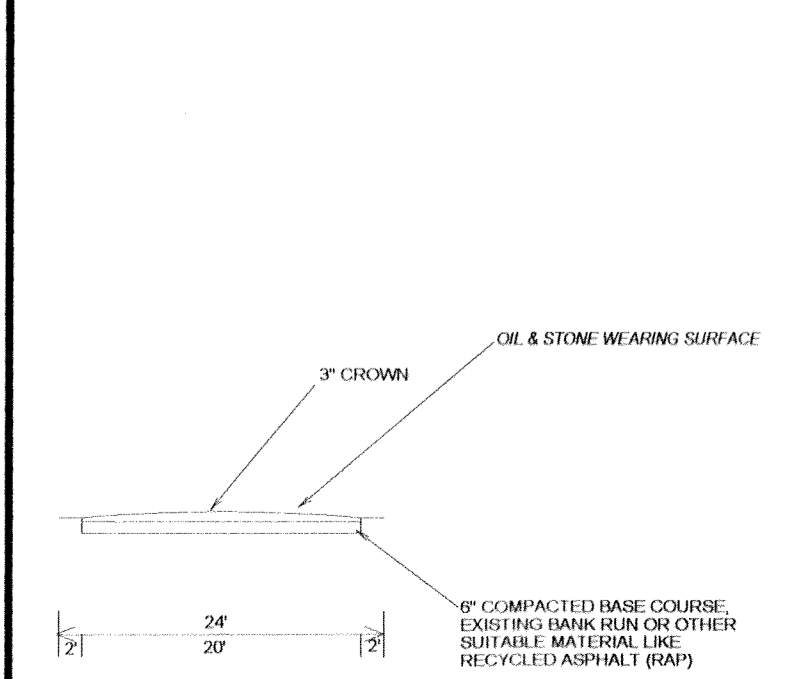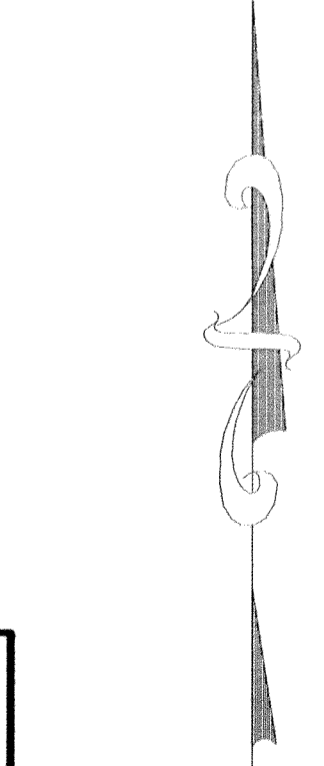

DRIVEWAY CROSS SECTION

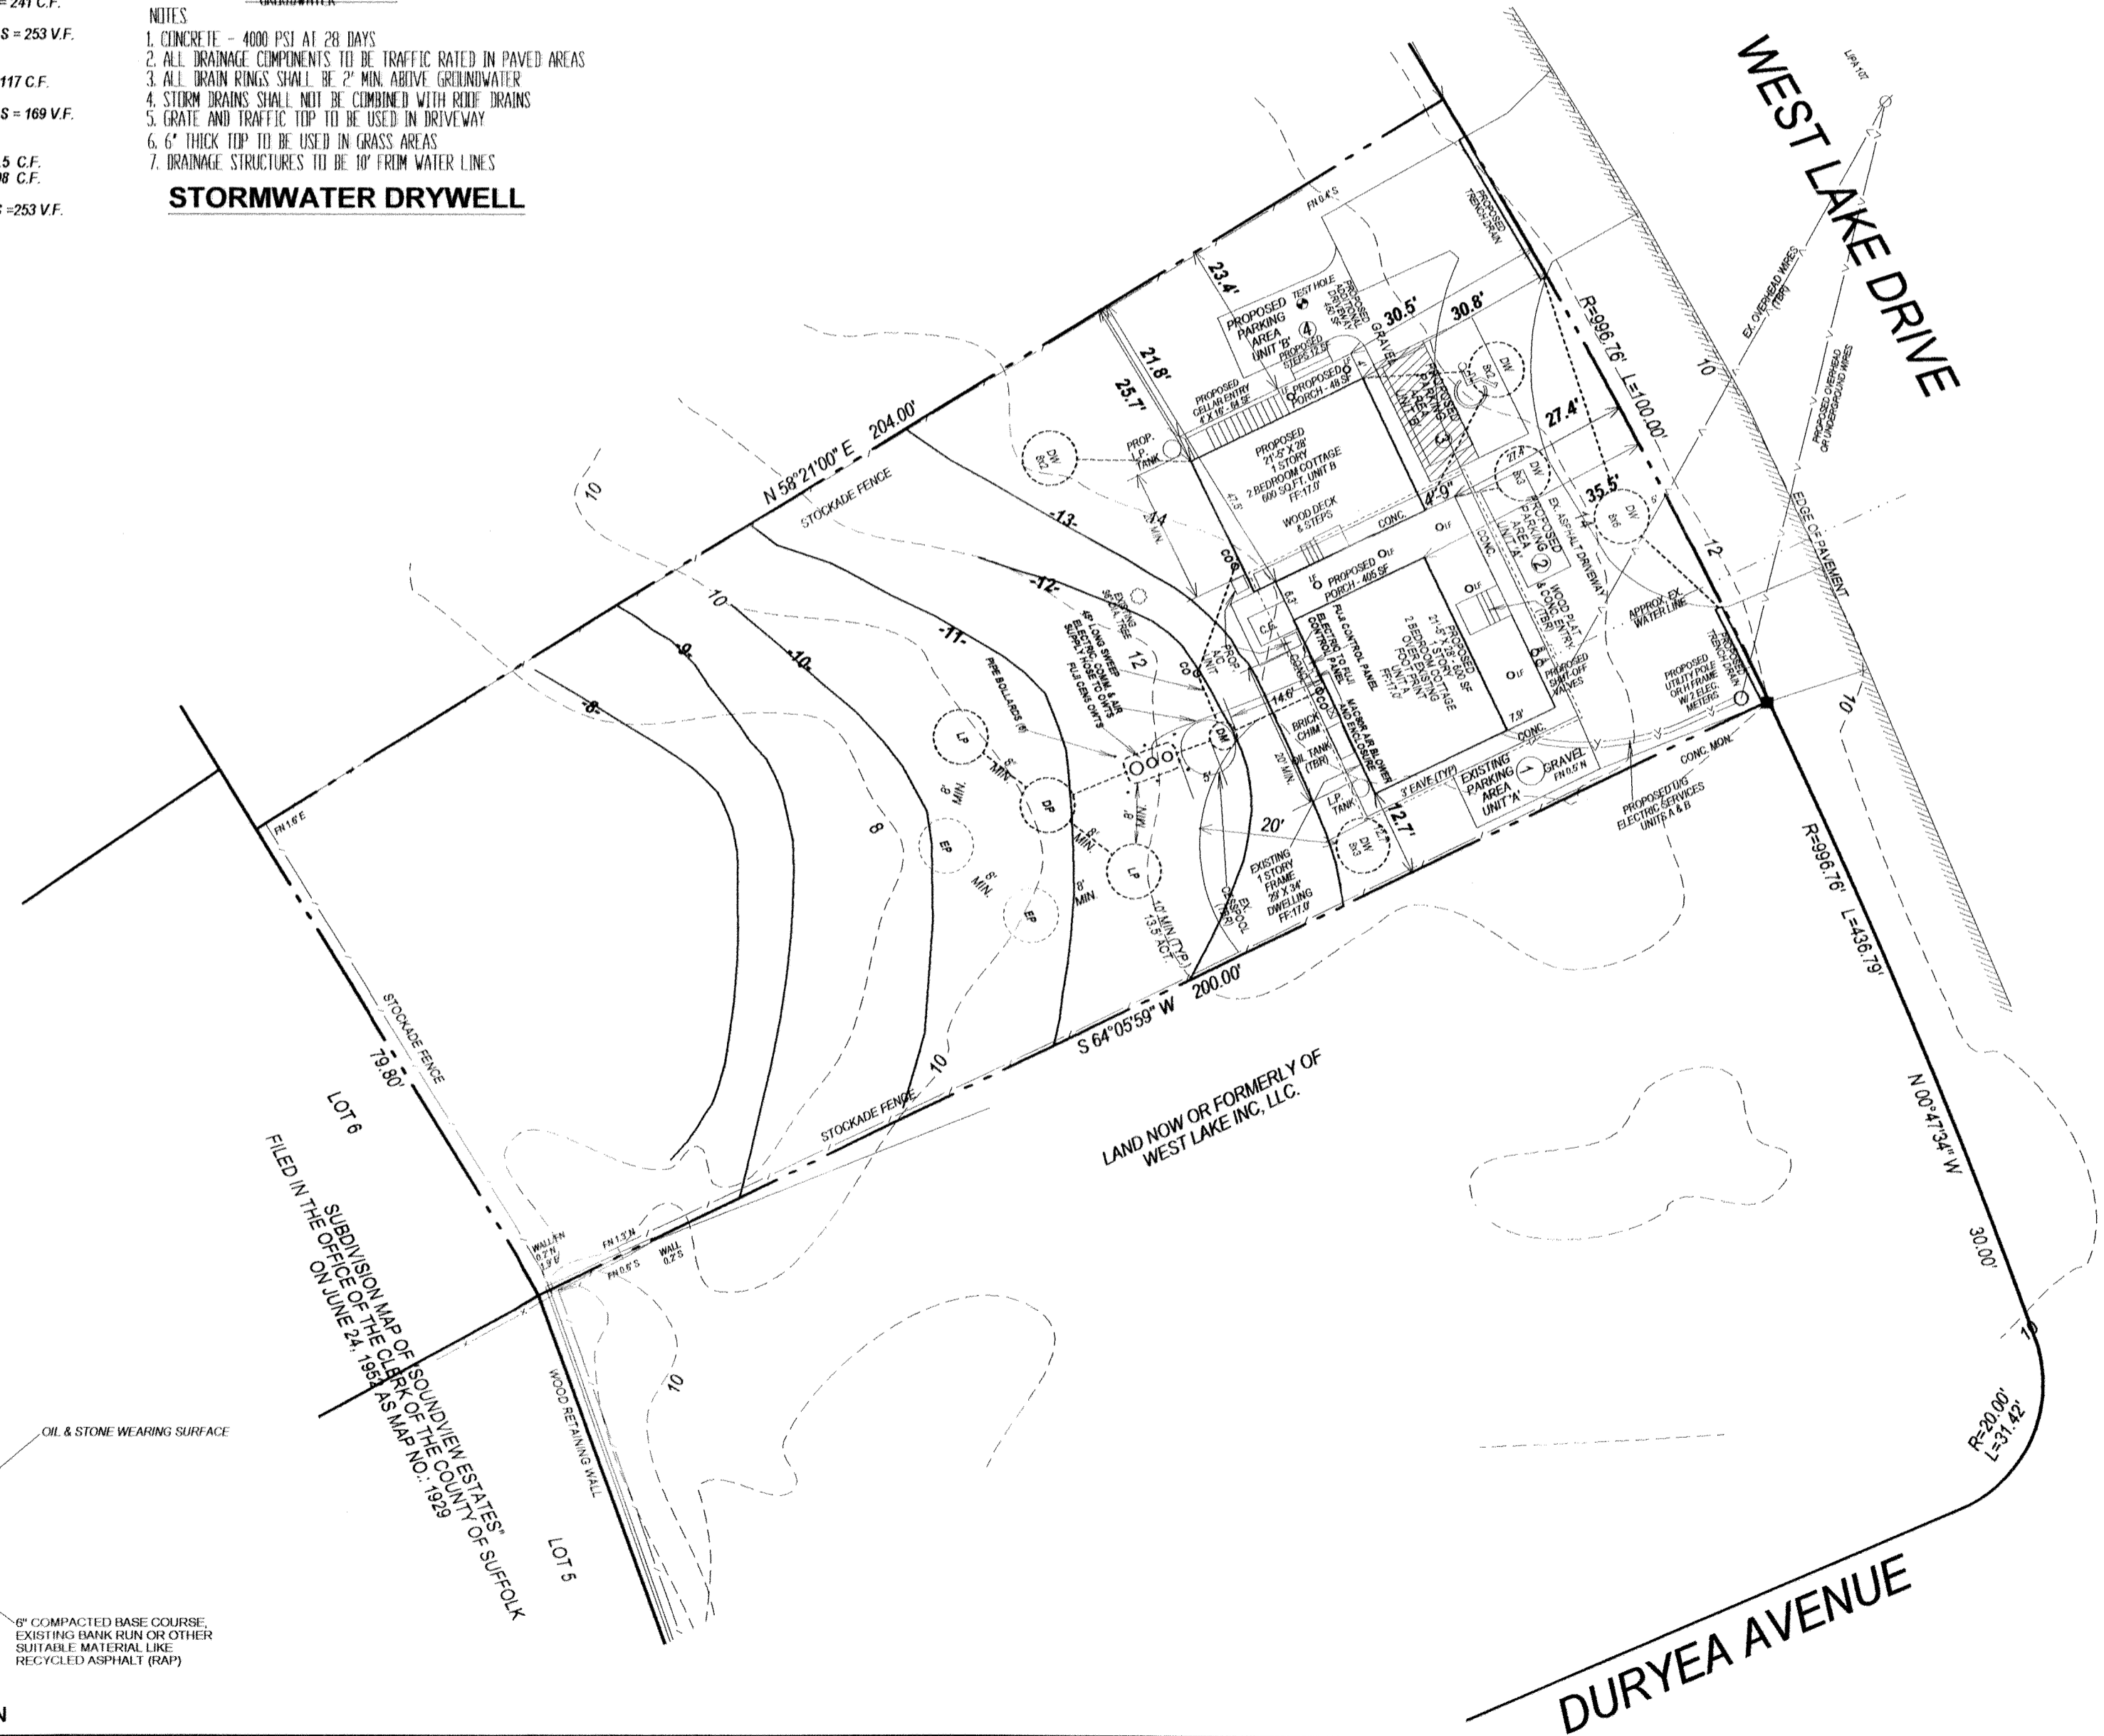

LAND SURVEYOR'S STATEMENT
I, MARTIN D. HAND, A LICENSED LAND SURVEYOR IN THE STATE OF NEW YORK, HAVE SURVEYED THE ABOVE DESCRIBED PROPERTY AND THE ADJACENT PROPERTY OF WEST LAKE INC. LLC. I HAVE FOUND THAT THE PROPERTY LINES AND CORNERS SHOWN ON THIS MAP ARE CORRECT AND ACCURATE TO THE BEST OF MY KNOWLEDGE AND BELIEF. I HAVE ALSO FOUND THAT THE PROPERTY LINES AND CORNERS SHOWN ON THIS MAP ARE CORRECT AND ACCURATE TO THE BEST OF MY KNOWLEDGE AND BELIEF. I HAVE ALSO FOUND THAT THE PROPERTY LINES AND CORNERS SHOWN ON THIS MAP ARE CORRECT AND ACCURATE TO THE BEST OF MY KNOWLEDGE AND BELIEF.